


# iCONsmart®

Micro Modules


## Installation Instructions




Humidity & Timer  
(HT) Module

Allows the user to control the humidity level of the room from 35% to 95%.


This gives access to the Humidity and Temperature usage data rolling log in the myAirflow app.

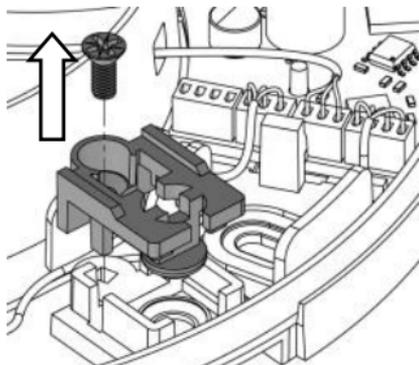

**HT1:** Remove the existing holder from the iCONsmart main body.

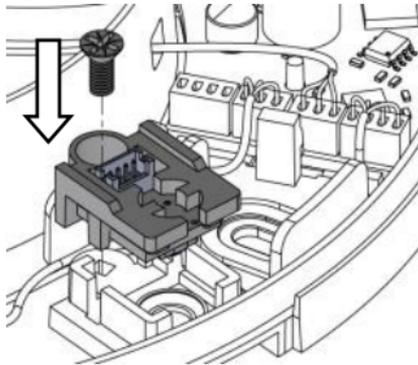

**HT2:** Place Humidity & Timer Module into the location shown above (the module will come with it's own holder) and screw into position.

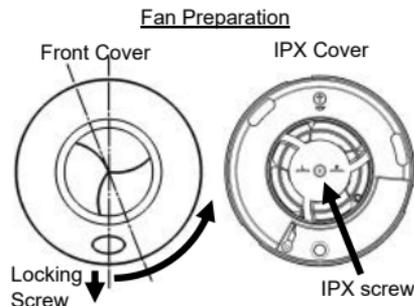


Locking  
Screw


IPX screw

Remove the locking screw from the bottom of the front cover and twist anticlockwise to remove.

Remove the IPX screw from the IPX cover and lift off to show the main body.

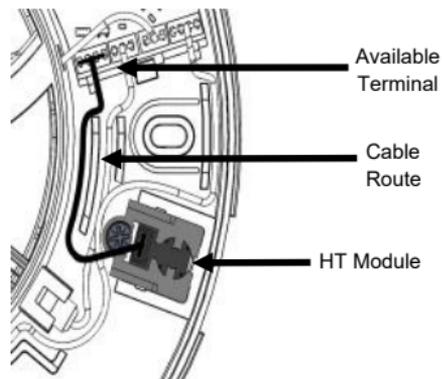


**HT3:** Attach the cable supplied into the Humidity & Timer Module and connect to the available terminal as labelled above.




Motion Sensor & Timer (MST) Module

Allows the user to activate motion sensing capabilities that trigger the iCONsmart when motion is detected.


Once installed, ensure to activate the motion sensor feature from the settings page in the myAirflow app.

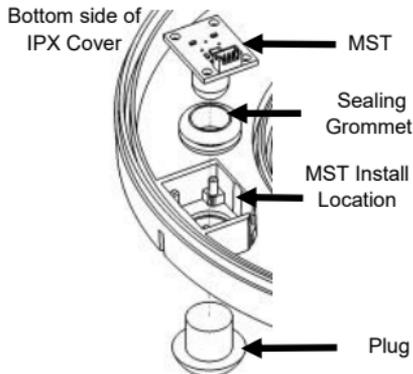

**MST1:** Remove the Plug already in the IPX cover. Replace with the Sealing Grommet.

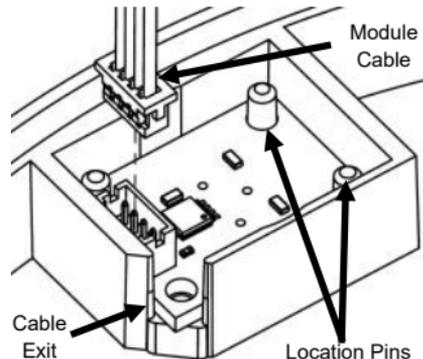

**MST2:** To position the MST module, ensure the location pins line up and press firmly into Sealing Grommet. Plug the cable provided into the MST module once secured in IPX cover.

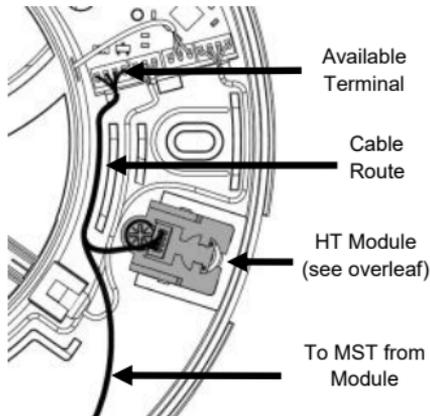

**MST3:** Connect this cable from MST into available terminal on the main body.

**NOTE:** When purchasing one module, one cable connector is supplied. When purchasing the combination of both modules (MSHT) you will be supplied with one connector that will fit the available terminal and both modules. If the HT and the MST modules are purchased separately please contact Airflow Developments Ltd.



White Lens



Translucent Lens

**MST4:** Firmly push the white oval lens cap from inside the front cover and replace with the translucent lens supplied with MST module.

# AIRFLOW

## Disposal

Do not dispose of with household waste. Please recycle where facilities exist.

Check with your local authority for recycling advice.



Airflow Developments Limited  
Aidelle House, Lancaster Road,  
Cressex Business Park  
High Wycombe, Buckinghamshire  
HP12 3QP, United Kingdom

E-Mail: [info@airflow.com](mailto:info@airflow.com)  
Telephone: +44 (0) 1494 525252

[airflow.com](http://airflow.com)

60000315—Issue 1 08/20